


OCTAGONAL EXPOSED
CONCRETE BASE

BELOW GRADE
CONCRETE
FOOTING



LAMPPOST SECURED TO CONCRETE
BASE WITH GALVANIZED
BREAK-AWAY ANCHOR BOLTS AS
REQUIRED BY MANUFACTURER (MIN
OF 4, 5/8" DIA. x 18" LONG)

PLAN

INSTALL NUTS TO SECURE BOLTS PER
MANUFACTURER INSTRUCTIONS

*REINFORCING: (4) #8 W/ #3 TIES
@ 12" O.C. (EXCEPT @ 3" FOR
TOP 2 TIES)
FINISHED GRADE


#6 GROUND WIRE

SCHEDULE 40 PVC
CONDUIT


3/4" X 10'-0" GROUND
ROD (COPPER CLAD STEEL
OR COPPER)

*FOOTING DESIGN TO
BE VERIFIED BY
CONSULTANT FOR
ACTUAL SOIL
CONDITIONS

SECTION/ELEVATION

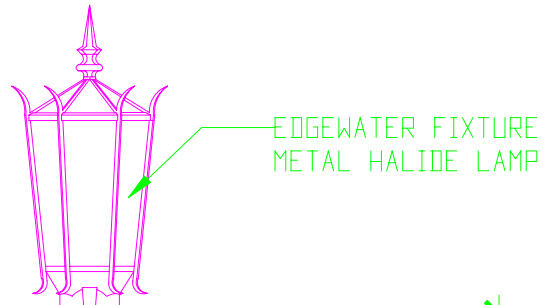

EDGEWATER FIXTURE
METAL HALIDE LAMP

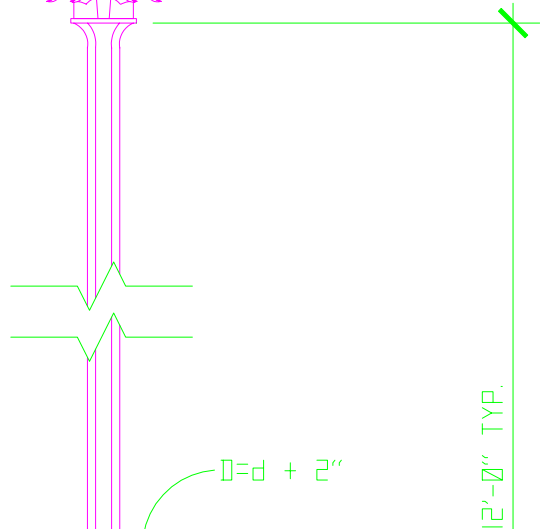

12'-0" TYP.

ACCESS PANEL
FOR ELECTRICAL
CONNECTION

3" MIN.

6" MIN.

24" MIN.

MINIMUM 9'-6" *

*D+6" DIA.
(MIN. 24"
DIA.)

CONCRETE BASE ON
COMPACTED
SUBGRADE

CAST IRON LIGHT

FIXTURE SW-1